

CHATHAM COUNTY PURCHASING DEPARTMENT

ADDENDUM NO. 2 TO Bid No. 12-0012-7

FOR: Emergency Generator Installation

PLEASE SEE THE FOLLOWING ADDITIONS, CLARIFICATIONS AND/OR CHANGES:

1. **Questions:** Please provide detail and specifications for the new fuel supply system from the existing tank to the relocated GENSET. The plans mention day tank & piping, but I cannot find any specifics. What size day-tank, what size piping, what type of piping & tank? Is any fuel containment required for the piping or for the new day tank ? Is the piping to be exposed ? Where is the day-tank to be located ? Is the piping to be dual-wall ?

Response: Day tank material, size and proposed location are shown on Detail C, Drawing E2.1 (upper left corner). Day tank shall be double-walled type. Fuel oil piping material shall be single-walled black iron, ¾ inch sized, with threaded fittings. Piping will be installed exposed. No other fuel oil containment is anticipated.

2. **Questions:** Please clarify statement 9 on addendum 1. What does “outside the facility” mean?

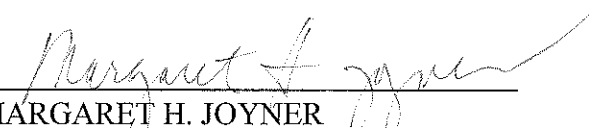
Response: “Outside the facility” means outside of the fence surrounding Office Building #1 and Maintenance Building #2. Both existing generator and “new” generator are inside the facility.

3. **Further Clarification:** The only work anticipated outside the facility fence is disconnection and removal of overhead power drop to Maintenance Building #2 performed by Georgia Power Co.. This work does not require a permit from City of Savannah.

THE BID OPENING SHALL REMAIN 2PM MARCH 13, 2012.

THE BIDDER IS RESPONSIBLE FOR MAKING THE NECESSARY CHANGES AND MUST ACKNOWLEDGE RECEIPT OF ADDENDUM.

03-08-12
DATE


MARGARET H. JOYNER
PURCHASING AGENT
CHATHAM COUNTY